


**18' TERRACE DRAIN**

**NOTES:**

1. CUT/FILL SLOPES EXCEEDING 30' IN VERTICAL HEIGHT SHALL BE TERRACED AT MIDHEIGHT OR AT MAXIMUM INTERVALS OF 30'.
2. TERRACES SHALL BE 6' WIDE EXCEPT THAT AN 18' WIDE TERRACE SHALL BE CONSTRUCTED AT EACH 60' INTERVAL FOR HEIGHT OF THE CUT OR FILL.
3. TERRACES SHALL BE PAVED A MINIMUM OF 6' WIDE.
4. MINIMUM LONGITUDINAL GRADE OF TERRACE SHALL BE 5%.
5. TERRACES SHALL BE PAVED WITH A MINIMUM OF 3" THICK REINFORCED CONCRETE OR AIR-BLOWN MORTAR.
6. CONCRETE OR AIR-BLOWN MORTAR SHALL BE COLORED MEDIUM OR DARK EARTH TONES (BLACK, TAN, SIENNA, AMBER, OCHRE, GREEN).
7. CONCRETE SHALL BE CLASS 500-C-2500.
8. AIR BLOWN MORTAR SHALL BE CLASS 600-E-3250.

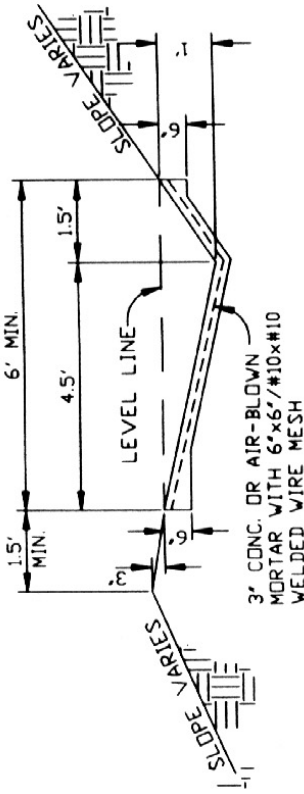

**6' TERRACE DRAIN**



REVISION	DATE
A	6-24-91

CITY OF ANAHEIM  
PUBLIC WORKS  
ENGINEERING DEPARTMENT

**TERRACE DRAIN**

APP *James E. Jensen* 6-26-91  
D.P.W./CITY ENGINEER DATE

APP *Arthur L. Daw* 6-24-91  
DEPUTY CITY ENGINEER DATE

STANDARD  
DETAIL NO. **326-A**