



CASE 3: A=900 mm (3') B= 900 mm (3') C= 1950 mm (6'-6") MIN  
 CASE 4: A=1200 mm (4') B=1200 mm (4') C=2250 mm (7'-6") MIN

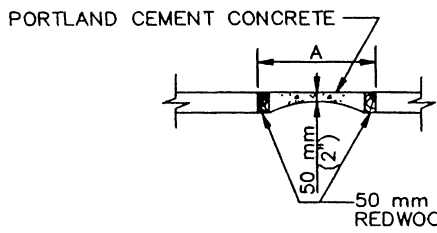

SECTION X - X

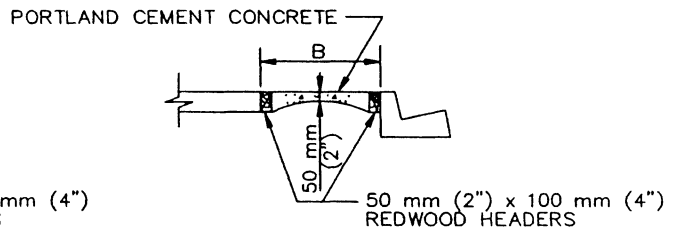

SECTION Y - Y

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE  
 PUBLIC WORKS STANDARD, INC.  
 GREENBOOK COMMITTEE  
 1984  
 REV. 1996

**TEMPORARY TREE WELL COVER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN  
 METRIC

**524-1**

SHEET 1 OF 2

NOTES

1. TREE WELLS SHALL BE SPACED APPROXIMATELY 15 m (50') APART, BUT NOT LESS THAN ONE PER RESIDENTIAL LOT.
2. LOCATION OF TREE WELLS SUBJECT TO THE FOLLOWING MINIMUM CLEARANCES:
  - A. 15 m (50') FROM THE BCR ON THE APPROACH TO AN INTERSECTION AND 4.5 m (15') FROM THE ECR ON THE EXIT SIDE.
  - B. 6 m (20') FROM LIGHT STANDARDS.
  - C. 3 m (10') FROM FIRE HYDRANTS AND DRIVEWAYS.
  - D. 1.5 m (5') FROM HOUSE WALKS AND UTILITY METERS.
3. TEMPORARY TREE WELL COVER SHALL BE TAPERED TO A 50 mm (2") THICKNESS AT THE CENTER FOR EASE OF BREAKING AND REMOVAL.
4. TEMPORARY TREE WELL COVER SHALL BE POURED IN PLACE. FINISH TO BE IDENTICAL WITH ADJACENT PCC WALK.
5. TEMPORARY TREE WELL COVER SHALL BE CASE 3 UNLESS OTHERWISE SPECIFIED.
6. LOCATION OF TREE WELL SUBJECT TO CHANGE AT THE DIRECTION OF THE ENGINEER.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**TEMPORARY TREE WELL COVER**

STANDARD PLAN  
METRIC

**524-1**

SHEET 2 OF 2